


WYAMZ Clavet Station - August 2020 Summary Report

Pollutants		Month Records		24-Hour Records				1-Hour Records			
Name	Conc. Unit	Avg. Conc.	Uptime	Maximum		SAAQS Objective	Exceed Days	Maximum		SAAQS Objective	Exceed Hours
				Conc.	Time			Conc.	Time		
NO	ppb	0.5	100.0%	1.4	Aug-23	-	-	15.3	Aug-23 03:00	-	-
NO ₂	ppb	1.8	100.0%	3.7	Aug-26	106	0	9.4	Aug-02 21:00	159	0
NO _x	ppb	2.3	100.0%	4.7	Aug-26	-	-	21.0	Aug-23 03:00	-	-
O ₃	ppb	25	100.0%	36	Aug-6	-	-	53	Aug-18 13:00	82	0
PM _{2.5}	ug/m3	6	100.0%	15	Aug-18	28	0	64	Aug-26 21:00	-	-

SAAQS: Saskatchewan Ambient Air Quality Standards




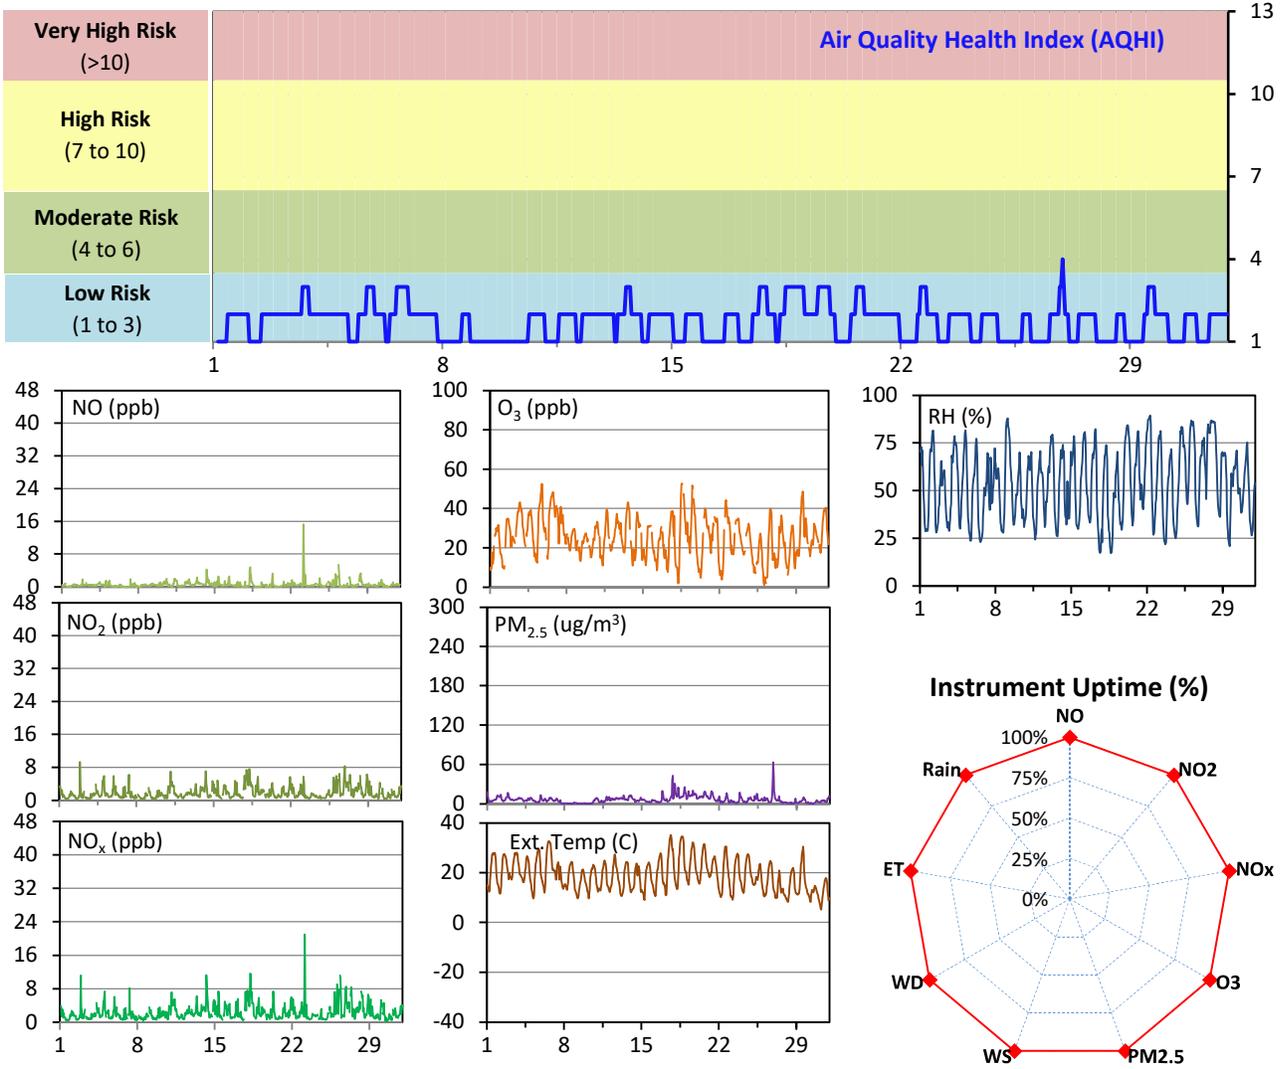


Monthly Update

- *All data has been slope, intercept, and baseline corrected. Data may change after validation process.
- *All compliance parameters were within the Saskatchewan Ambient Air Quality Standards.
- *All compliance parameters were greater than 90% operational for the month.



WYAMZ Clavet Station - August 2020 Summary Report

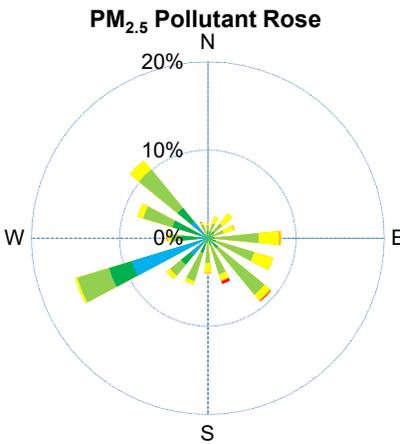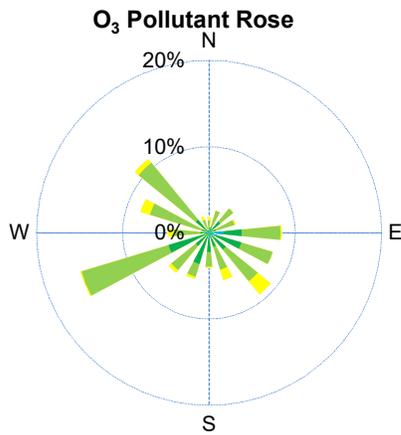
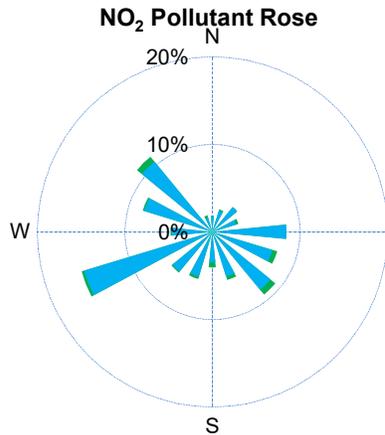
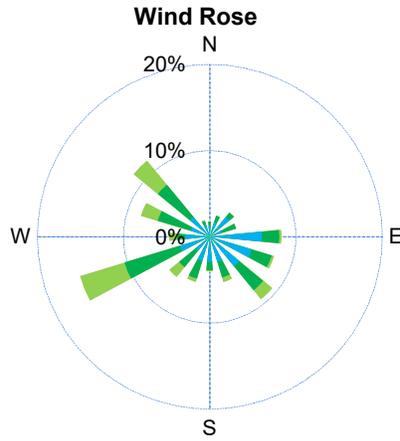


Parameters	Unit	Color Code for Wind Spd & Pollutant Conc. Class					
Wind Speed	m/s	$0.3 \leq WS < 1.4$	$1.4 \leq WS < 3.1$	$3.1 \leq WS < 7.8$	$7.8 \leq WS < 10.8$	$10.8 \leq WS < 13.6$	$WS \geq 13.6$
NO ₂	ppb	$0 \leq C < 5$	$5 \leq C < 15$	$15 \leq C < 30$	$30 \leq C < 100$	$100 \leq C < 212$	$C \geq 212$
O ₃	ppb	$0 \leq C < 10$	$10 \leq C < 20$	$20 \leq C < 40$	$40 \leq C < 60$	$60 \leq C < 82$	$C \geq 82$
PM _{2.5}	ug/m ³	$0 \leq C < 2$	$2 \leq C < 4$	$4 \leq C < 10$	$10 \leq C < 20$	$20 \leq C < 30$	$C \geq 30$

WYAMZ Kerrobert Station - August 2020 Summary Report

Pollutants		Month Records		24-Hour Records				1-Hour Records			
Name	Conc. Unit	Avg. Conc.	Uptime	Maximum		SAAQS Objective	Exceed Days	Maximum		SAAQS Objective	Exceed Hours
				Conc.	Time			Conc.	Time		
SO ₂	ppb	#VALUE!	0.0%	< 0.1	#N/A	48	0	< 0.1	-	172	0
H ₂ S	ppb	#VALUE!	0.0%	< 0.1	#N/A	3.6	0	< 0.1	-	11	0
PM _{2.5}	ug/m3	#VALUE!	0.0%	< 1	#N/A	28	0	< 1	-	-	-

SAAQS: Saskatchewan Ambient Air Quality Standards

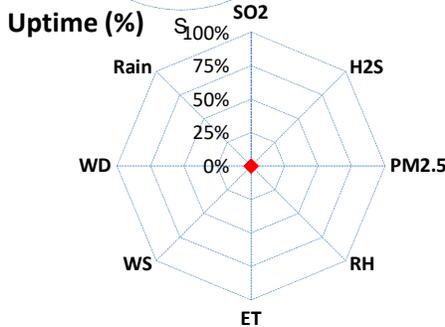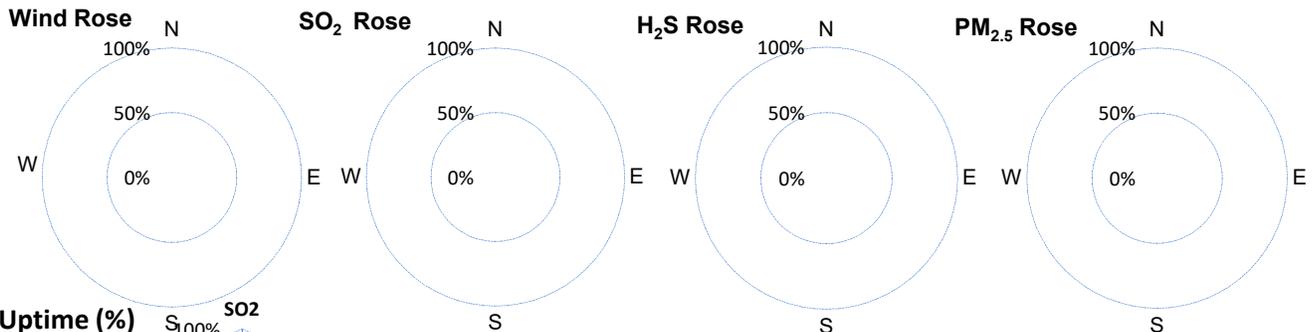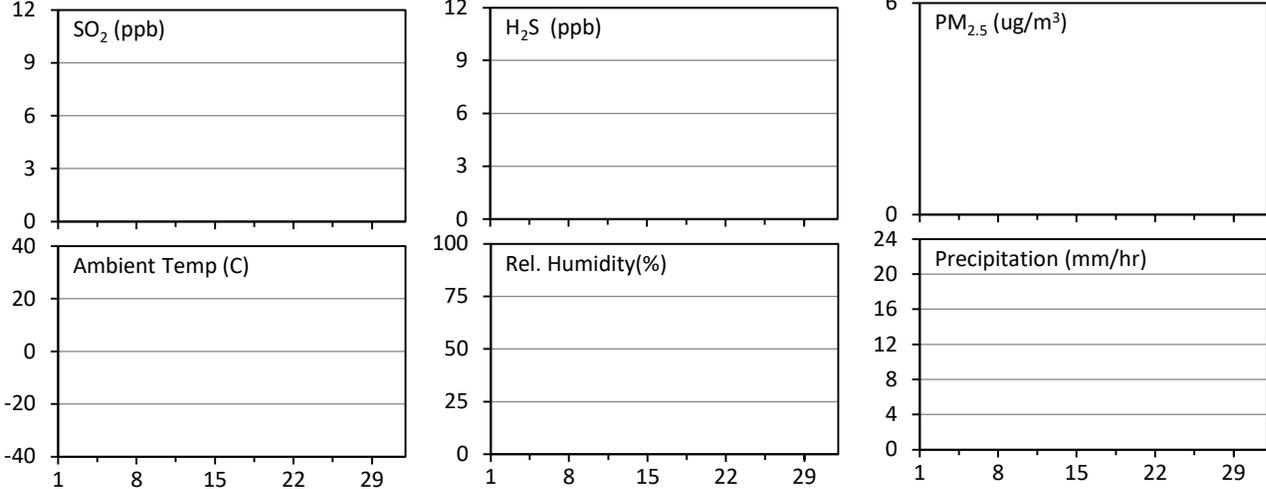

Parameters	Unit	Color Code for Wind Spd & Pollutant Conc. Class					
Wind Speed	m/s	0.3 ≤ WS < 1.4	1.4 ≤ WS < 3.1	3.1 ≤ WS < 7.8	7.8 ≤ WS < 10.8	10.8 ≤ WS < 13.6	WS ≥ 13.6
SO ₂	ppb	0 ≤ C < 1	1 ≤ C < 5	5 ≤ C < 10	10 ≤ C < 57	57 ≤ C < 172	C ≥ 172
H ₂ S	ppb	0 ≤ C < 1	1 ≤ C < 3.6	3.6 ≤ C < 5	5 ≤ C < 8	8 ≤ C < 10.8	C ≥ 10.8
PM _{2.5}	ug/m ³	0 ≤ C < 2	2 ≤ C < 4	4 ≤ C < 10	10 ≤ C < 20	20 ≤ C < 30	C ≥ 30

Monthly Update

*All data has been slope, intercept, and baseline corrected. Data may change after validation process.

*All compliance parameters were within the Saskatchewan Ambient Air Quality Standards.

*All compliance parameters were less than 90% operational.





* The station is not operational.



WYAMZ Maidstone Station - August 2020 Summary Report

Pollutants		Month Records		24-Hour Records				1-Hour Records			
Name	Conc. Unit	Avg. Conc.	Uptime	Maximum		SAAQS Objective	Exceed Days	Maximum		SAAQS Objective	Exceed Hours
				Conc.	Time			Conc.	Time		
NO	ppb	0.3	100.0%	0.8	Aug-1	-	-	4.4	Aug-01 06:00	-	-
NO ₂	ppb	1.0	100.0%	2.2	Aug-13	106	0	6.8	Aug-13 05:00	159	0
NO _x	ppb	1.2	100.0%	2.5	Aug-1	-	-	7.5	Aug-13 05:00	-	-
SO ₂	ppb	0.4	100.0%	1.9	Aug-6	48	0	8.7	Aug-17 10:00	172	0
H ₂ S	ppb	0.7	100.0%	1.1	Aug-26	3.6	0	29.5	Aug-05 06:00	11	2
PM _{2.5}	ug/m3	5	100.0%	10	Aug-20	28	0	26	Aug-29 20:00	-	-

SAAQS: Saskatchewan Ambient Air Quality Standards

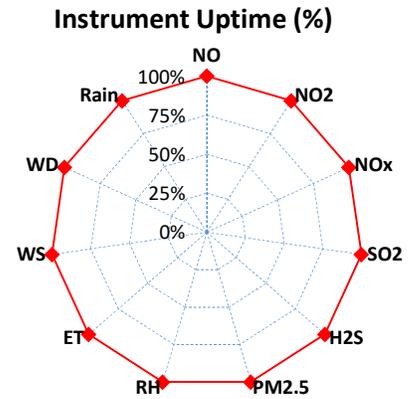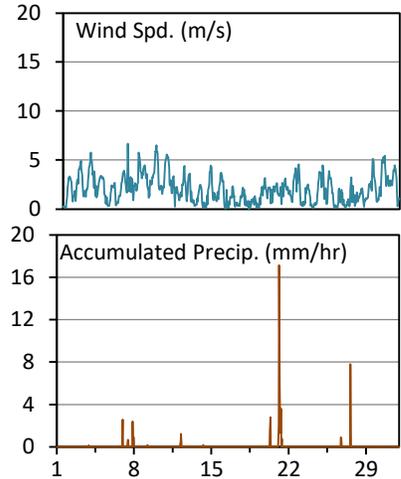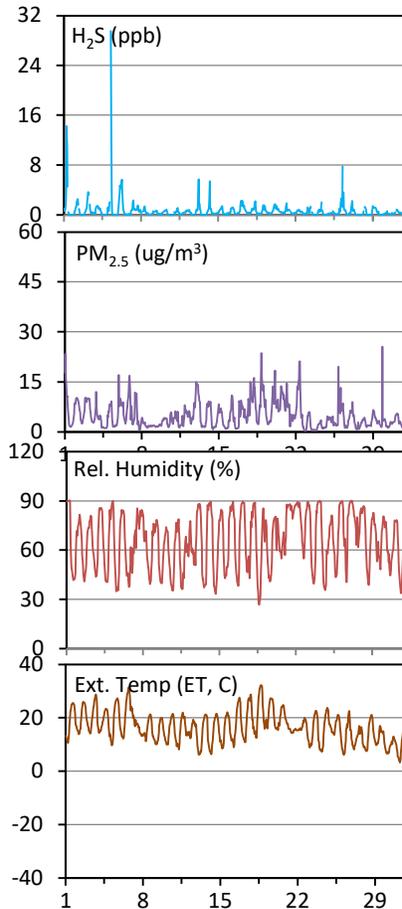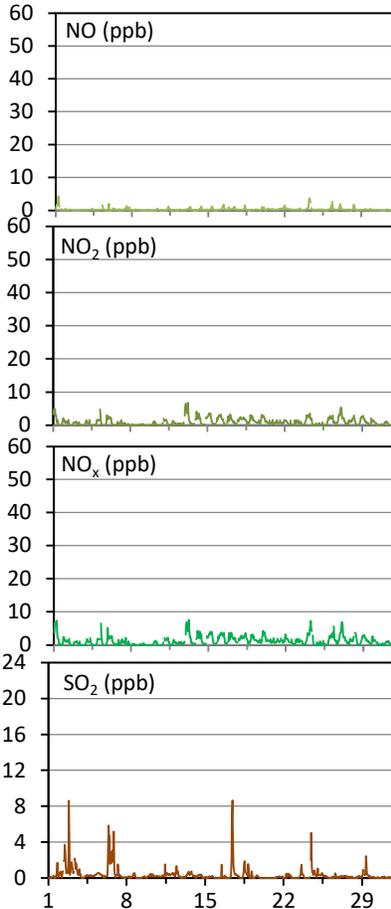


Monthly Update

* All data has been slope, intercept, and baseline corrected. Data may change after validation process.

* All compliance parameters were within the Saskatchewan Ambient Air Quality Standards with the exception of two 1-hour H₂S exceedances.

* All compliance parameters were greater than 90% operational.

WYAMZ Maidstone Station - August 2020 Summary Report

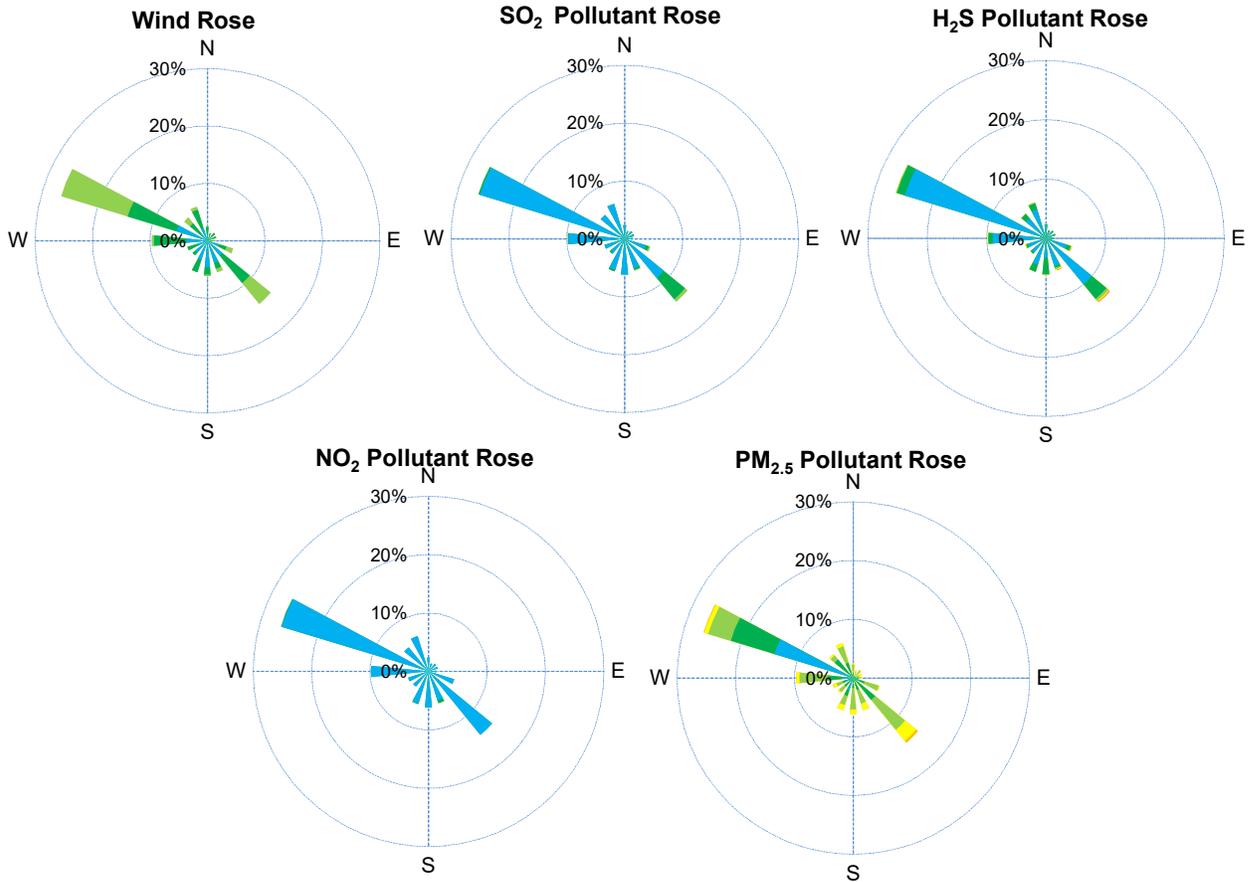


Parameters	Unit	Color Code for Wind Spd & Pollutant Conc. Class					
Wind Speed	m/s	0.3 ≤ WS < 1.4	1.4 ≤ WS < 3.1	3.1 ≤ WS < 7.8	7.8 ≤ WS < 10.8	10.8 ≤ WS < 13.6	WS ≥ 13.6
SO ₂	ppb	0 ≤ C < 1	1 ≤ C < 5	5 ≤ C < 10	10 ≤ C < 57	57 ≤ C < 172	C ≥ 172
NO ₂	ppb	0 ≤ C < 5	5 ≤ C < 15	15 ≤ C < 30	30 ≤ C < 100	100 ≤ C < 212	C ≥ 212
H ₂ S	ppb	0 ≤ C < 1	1 ≤ C < 3.6	3.6 ≤ C < 5	5 ≤ C < 8	8 ≤ C < 10.8	C ≥ 10.8

WYAMZ Meadow Lake City Station - August 2020 Summary Report

Pollutants		Month Records		24-Hour Records				1-Hour Records			
Name	Conc. Unit	Avg. Conc.	Uptime	Maximum		SAAQS Objective	Exceed Days	Maximum		SAAQS Objective	Exceed Hours
				Conc.	Time			Conc.	Time		
NO	ppb	0.3	100.0%	0.7	Aug-17	-	-	5.1	Aug-06 07:00	-	-
NO ₂	ppb	1.1	100.0%	2.3	Aug-18	106	0	9.9	Aug-28 20:00	159	0
NO _x	ppb	1.4	100.0%	2.6	Aug-18	-	-	12.3	Aug-28 20:00	-	-
O ₃	ppb	22	100.0%	33	Aug-7	-	-	48	Aug-07 14:00	82	0
PM _{2.5}	ug/m3	5	100.0%	12	Aug-18	28	0	43	Aug-28 20:00	-	-

SAAQS: Saskatchewan Ambient Air Quality Standards

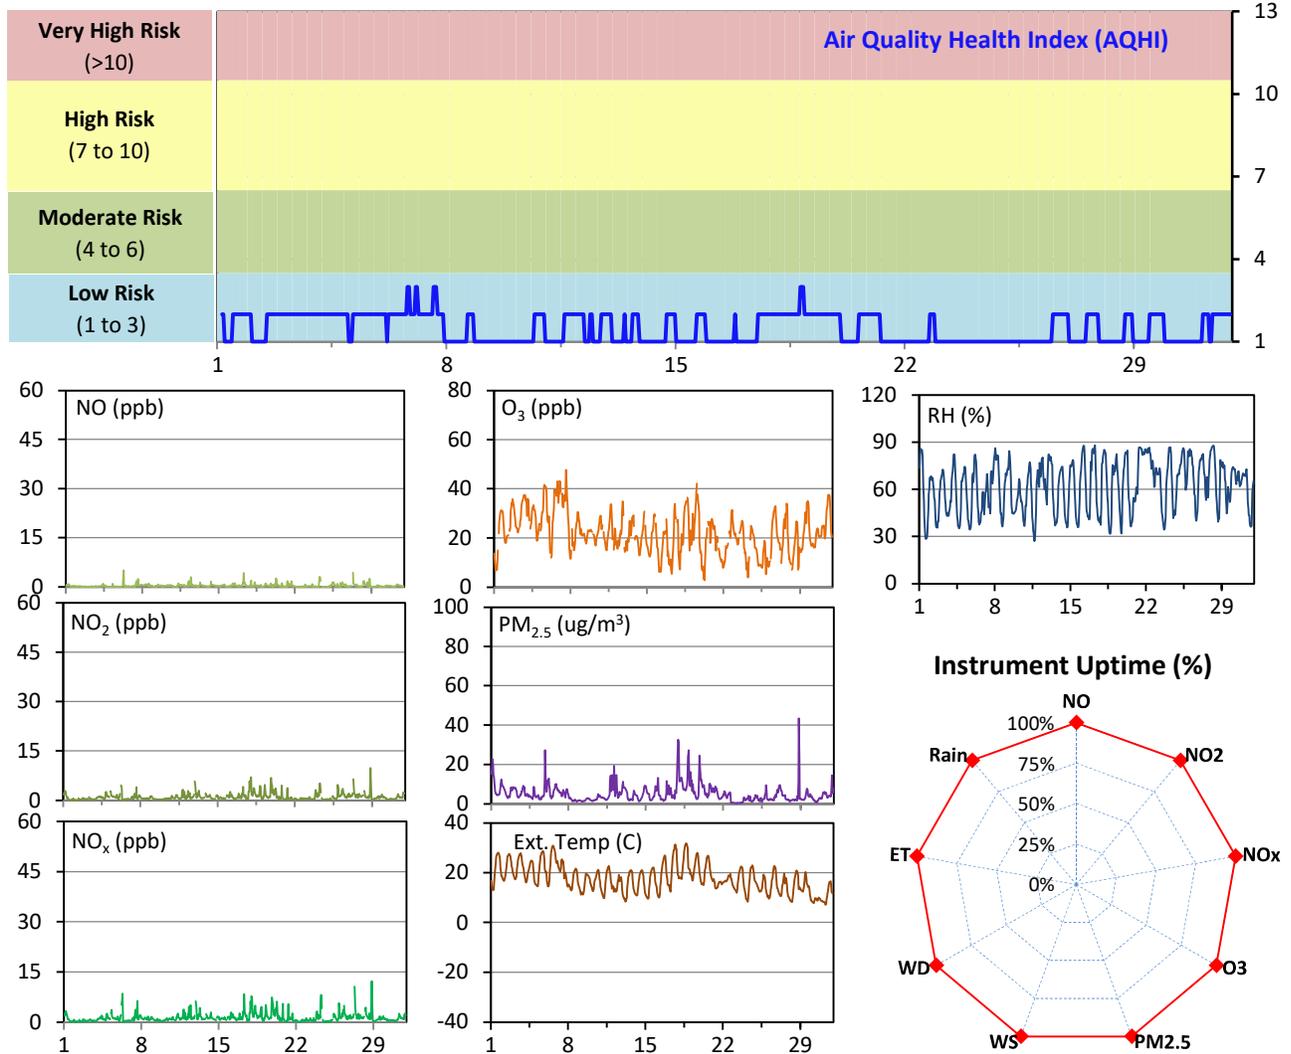

Monthly Update





*All data has been slope, intercept, and baseline corrected. Data may change after validation process.

*All compliance parameters were within the Saskatchewan Ambient Air Quality Standards.

*All compliance parameters were greater than 90% operational.



WYAMZ Meadow Lake City Station - August 2020 Summary Report

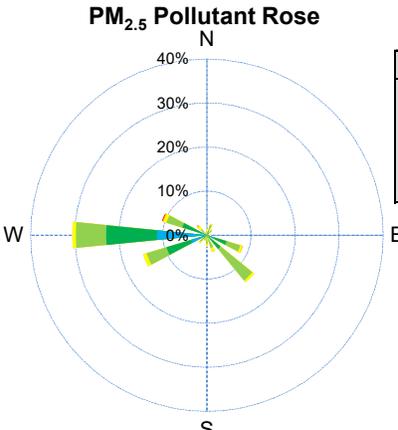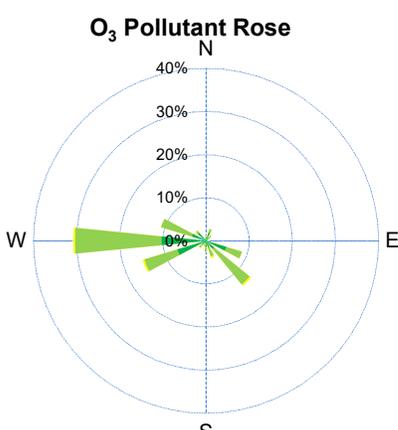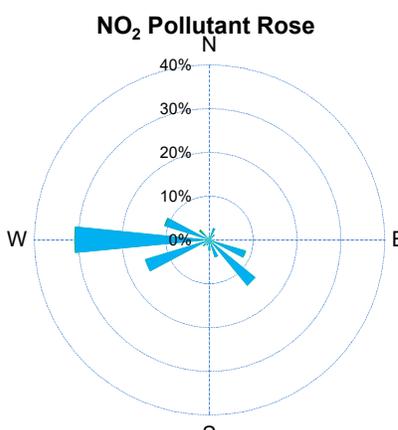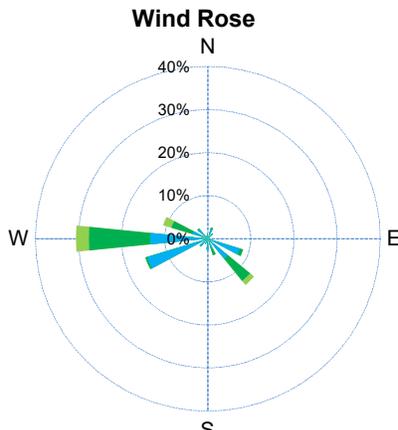

Parameters	Unit	Color Code for Wind Spd & Pollutant Conc. Class					
Wind Speed	m/s	$0.3 \leq WS < 1.4$	$1.4 \leq WS < 3.1$	$3.1 \leq WS < 7.8$	$7.8 \leq WS < 10.8$	$10.8 \leq WS < 13.6$	$WS \geq 13.6$
NO ₂	ppb	$0 \leq C < 5$	$5 \leq C < 15$	$15 \leq C < 30$	$30 \leq C < 100$	$100 \leq C < 212$	$C \geq 212$
O ₃	ppb	$0 \leq C < 10$	$10 \leq C < 20$	$20 \leq C < 40$	$40 \leq C < 60$	$60 \leq C < 82$	$C \geq 82$
PM _{2.5}	ug/m ³	$0 \leq C < 2$	$2 \leq C < 4$	$4 \leq C < 10$	$10 \leq C < 20$	$20 \leq C < 30$	$C \geq 30$

